

Accessory for SIRIUS 3RM1 3-phase busbar for 2 motor starters
Modular spacing 22.5 mm Screw connection system

General technical data		
product brand name		SIRIUS
product designation		3-phase busbar
design of the product		For 2 motor starters
suitability for use		Motor starter 3RM1
product function short circuit protection		No
installation altitude at height above sea level maximum	m	2 000
ambient temperature		
• during operation	°C	-25 ... +60
• during transport	°C	-40 ... +70
• during storage	°C	-40 ... +70
insulation voltage rated value	V	500
reference code according to IEC 81346-2		X

Main circuit		
relative symmetrical tolerance of the operating voltage	%	10
ampacity maximum	A	25
operational current at AC at 480 V according to UL 508	A	16

Installation/ mounting/ dimensions		
mounting position		any
fastening method		screw fixing
width	mm	46
height	mm	41
depth	mm	12

Certificates/ approvals	
General Product Approval	EMV Test Certificates



[Type Test Certificates/Test Report](#)

other	Railway	Environment
-------	---------	-------------



[Confirmation](#)

[Special Test Certificate](#)

[Environmental Confirmations](#)

Further information
Information on the packaging

<https://support.industry.siemens.com/cs/ww/en/view/109813875>

Information for data generation and storage

<https://support.industry.siemens.com/cs/ww/en/view/109995012>

Information- and Downloadcenter (Catalogs, Brochures,...)

<https://www.siemens.com/ic10>

Industry Mall (Online ordering system)

<https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RM1910-1AA>

Cax online generator


<https://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RM1910-1AA>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<https://support.industry.siemens.com/cs/ww/en/ps/3RM1910-1AA>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...)

https://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RM1910-1AA&lang=en

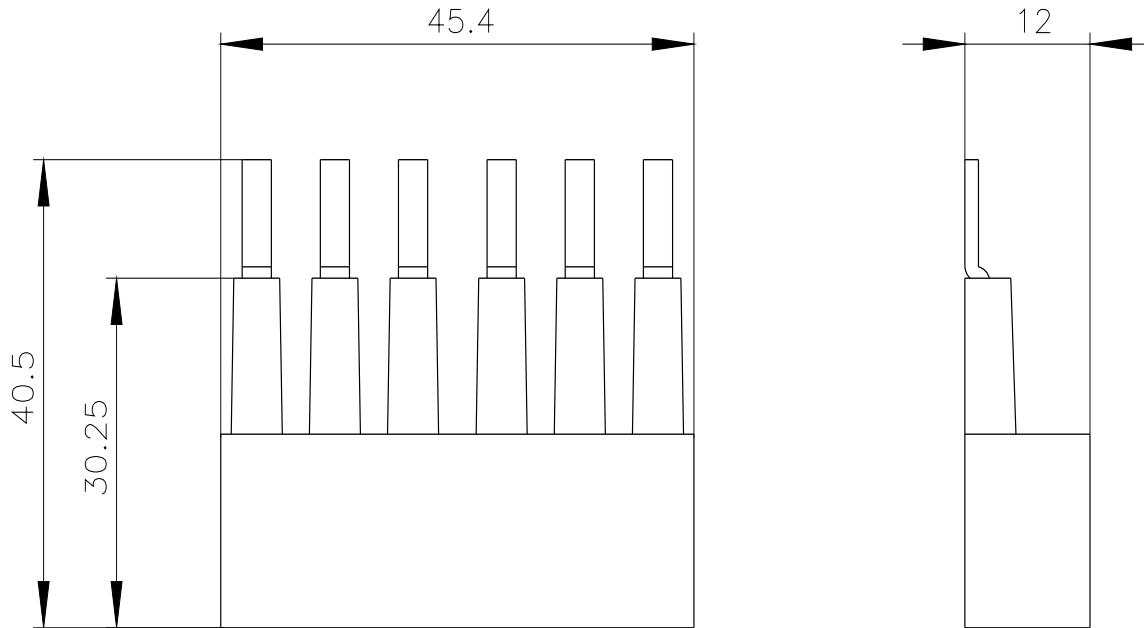

last modified:

4/1/2025 